

MAC10 Series Digital Controller Communication Interface (RS - 485) Instruction Manual

Thank you for purchasing SHIMAX product. Please check that the product is the one you ordered.
Please operate after you read the instruction manual and fully understand it.

This instructions manual describes the communication interface, or option function of digital controller MAC10. See the attached main body's instructions manual about operation of MAC10, and the details of each parameter.

Table of Contents

<p>1. Outline 2</p> <p>2. Specification 2</p> <p>3. Connection with Host Computer 3</p> <p style="padding-left: 20px;">3-1 RS-485 3</p> <p style="padding-left: 20px;">3-2 Control of Three State Output 3</p> <p>4. Setup Concerning Communication 4 ~ 5</p> <p style="padding-left: 20px;">4-1 Setup of Communication Speed 4</p> <p style="padding-left: 20px;">4-2 Setup of Communication Parity 4</p> <p style="padding-left: 20px;">4-3 Setup of Communication Stop Bit 4</p> <p style="padding-left: 20px;">4-4 Setup of Start Character 4</p> <p style="padding-left: 20px;">4-5 Setup of BCC Operation Type 4</p> <p style="padding-left: 20px;">4-6 Setup of Communication Address 5</p> <p style="padding-left: 20px;">4-7 Setup of Delay Time 5</p> <p style="padding-left: 20px;">4-8 Setup in Communication Memory Mode 5</p>	<p>5. Outline of Standard Serial Communications Protocol 6 ~ 14</p> <p style="padding-left: 20px;">5-1 Communication Step 6</p> <p style="padding-left: 20px;">5-2 Communication Format 6</p> <p style="padding-left: 20px;">5-3 Read Command (R) Details 10</p> <p style="padding-left: 20px;">5-4 Write Command (W) Details 12</p> <p style="padding-left: 20px;">5-5 Answering Code Details 13</p> <p style="padding-left: 20px;">5-6 Communication Data Address Details 14</p> <p>6. Outline of MODBUS Communication Protocol 15 ~ 23</p> <p style="padding-left: 20px;">6-1 Communication Procedure 15</p> <p style="padding-left: 20px;">6-2 Communication Format 16</p> <p style="padding-left: 20px;">6-3 Error Checking 18</p> <p style="padding-left: 20px;">6-4 Data Read-out Details 19</p> <p style="padding-left: 20px;">6-5 Data Write-in Details 20</p> <p style="padding-left: 20px;">6-6 Loopback Test Details 21</p> <p style="padding-left: 20px;">6-7 No Response Conditions 21</p> <p style="padding-left: 20px;">6-8 Error Message Details 22</p> <p style="padding-left: 20px;">6-9 Communication Data Address Details 23</p> <p>7. Communication Data Address List 24 ~ 26</p> <p>8. Supplementary Explanation 27</p> <p style="padding-left: 20px;">9-1 Measuring Range Code Table 27</p> <p style="padding-left: 20px;">9-2 Event Code Table 27</p> <p>9. ASCII Code Table 27</p>
---	--

1. Outline

The MAC10 communication interface has adopted the communication method of RS-485.

The various data can be set up with the signal based on EIA standard, or it can read with the personal computer etc.

RS-485 is the data communication standard decided by the Electronic Industries Alliance (EIA).

This standard specified so-called electric and mechanical hardware.

The software portion of the data transmission procedure is not specified.

Therefore, the set with the same interface cannot always communicate each other.

Therefore, the customer fully needs to understand specification and the transmission procedure beforehand.

Use of RS-485 makes it possible to carry out parallel connection of two or more MAC10.

Not many personal computers seem to support this interface.

RS-232C \longleftrightarrow RS-485

However, use of the line converter makes it possible.

2. Specification

Protocol	: SHIMAX standard serial protocol, MODBUS ASCII, MODBUS RTU
Signal level	: in conformity with EIA RS-485
Communication method	: RS-485 Two-wire system Half duplex Multidrop (bus) system
Synchronic system	: Start-stop Synchronous system
Communication range	: RS-485 Maximum 500m totally (depends on the environmental condition)
Transmission speed	: 9600 and 19200 bps
Transmission procedure	: No procedure
Start bit	: 1 bit
Data length	: 8 bits
Parity bit	: nothing, the even number, odd number
Stop bit	: 1 bit, 2 bits
Communication code	: ASCII code (SHIMAX standard serial protocol, MODBUS ASCII) Binary code (MODBUS RTU)
Connectable maxim number	: 32 (Including a host controller)
Insulation	: A communication circuit and other circuits are insulated(Basic or Functional insulation). MAC10 is basic insulation to various input and output, and electric power source

*MODBUS is a registered trademark of Schneider Electric.

3. Connection with Host Computer


3-1. RS-485

The input-and-output logic level of MAC10 is fundamentally as follows.

mark (1) state - terminal < + terminal
 mark (0) state - terminal > +terminal

However, + terminal and - terminal of the controller are high impedance until just before starting transmission, the above-mentioned level is output. (See 3-2. Control of Three State Control)

[RS-485]

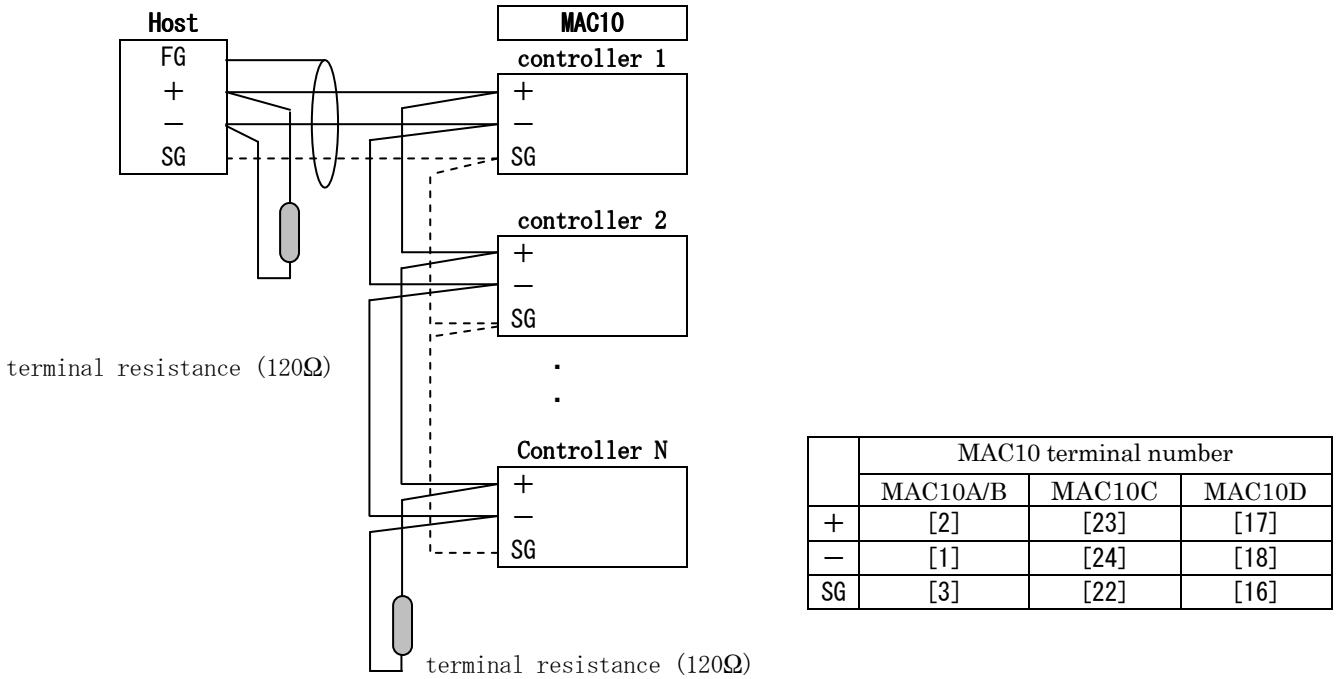


Note 1: Attach 1/2W 120Ω terminal resistance of between the host side and one end terminal equipment (between + and -) at the time of operation.


Note 2: Please be sure to connect one side of a shield to the ground.
 When wiring by a shielding wire cannot be performed, the customer should take the measure against lightning surge.

3-2. Control of Three State Output

RS-485 is a multidrop system. Transmitting output is always high impedance at the time of un-communicating and reception, in order to avoid the collision of a transmitted signal. Just before transmitting, it changes to a normal output state from high impedance. And it returns to high impedance again at the same time transmission is completed. However, the control of 3 state control has about 2 msec (MAX.) time-lag. Set up more than several msec delay time, when the host side starts transmission immediately after the end of reception.

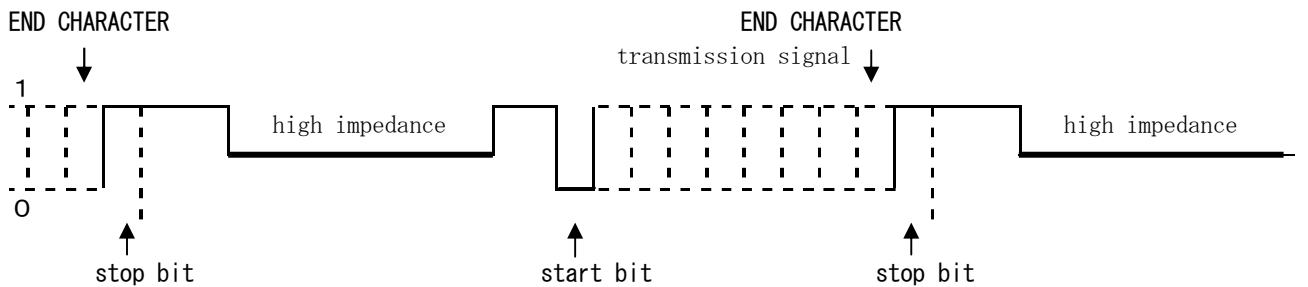

4. Setup Concerning Communication



MAC10 has 8 kinds of parameters concerning communication after Mode 9. These cannot perform setting change by communication except for a communication memory mode setup. Perform it by a front key.

MENU key
↓

4-1. Setup of Communication Speed



Initial value : 96
Setting range : 96 (9600bps) , 192 (19200bps),

The transmission speed for transmitting data to a host is chosen and set up.

MENU key
↓

4-2. Setup of Communication Parity



Initial value : none
Setting range : none, odd number, even number
Communication parity is chosen and set up.

MENU key
↓


4-3. Setup of Communication Stop Bit



Initial value : 1
Setting range : 1,2
Communication stop bit is chosen and set up.

MENU key
↓

4-4. Setup of Start Character



Initial value : STX
Setting range : STX,ATT
Control code to be used is chosen. (Effective only when SHIMAX standard serial protocol is on)

MENU key
↓

choice	start character	text end character	end character
STX	STX(02H)	ETX(03H)	CR(0DH)
ATT	"@(40H)	:"(3AH)	CR(0DH)

4-5. Setup of BCC Operation Type




Initial value : none
Setting range : none,Add,Add2,Xor,LrC,Cr16
BCC operation type is chosen. **The content selected here determines the protocol.**

MENU key
↓

choice	operation method	protocol
none	none	SHIMAX standard serial protocol
Add	addition	
Add 2	addition + complement of 2	
Xor	exclusive OR	
LrC	LRC	MODBUS ASCII
Cr16	CRC-16	MODBUS RTU

4-6. Setup of Communication Address (Slave Address)



Initial value : 1

Setting range : 1~255

RS-485 adopts the multidrop system and up to 31 equipments (maximum) are connectable.


By allotting an address (machine No.) to the each equipment, only specified-address holding equipment can respond.

MENU key

Note 1: An address can be set up to 1~255. However, the maximum number of connectable equipment is 31.

Note 2: The numbers of addresses you can appoint as a slave is 1~247 in the specification of MODBUS. (Since appointment is possible in 1~255)

4-7. Setup of Delay Time



Initial value : 20

Setting range : 1~250(msec)

The minimum delay time, from receiving a communication command to actual transmission, can be set up.

MENU key

Note 1: A certain line converter may require longer time for 3 state control, and a signal collision may occur in the case of RS-485. If delay time is lengthened, it is avoidable.

Note 2: The actual delay time, from receiving communication command to actual transmission, is the sum total of the above-mentioned delay time, and the processing time by software. Especially in the case of write command, command processing time may require around 400 msec.

4-8. Setup in Communication Memory Mode



Initial value : RAM

Setting range : RAM,MIX,EEP

Since write cycle of nonvolatile memory EEPROM is limited, the life of EEPROM becomes shorter when data is frequently rewritten by communication.

Set up RAM mode when data is frequently rewritten by communication. Life of EEPROM can be lengthened, if only RAM data is rewritten without rewriting EEPROM.

* Data address "05B0"(Communication memory mode) is always written in at an EEPROM regardless of this setting.

MENU key

choice	content of processing
RAM	In this mode, in changing data by communication, only RAM is rewritten. RAM data will be eliminated if power is turned OFF without rewriting to EEPROM. If power is turned on again, it will start by the data memorized by EEPROM.
MIX	In this mode, the data of FIX-SV 1-4 and OUT 1 manual output value is written only in RAM, and the other data are written in RAM and EEPROM.
EEP	Everytime the data is changed by communication, rewriting of RAM and EEPROM is performed. The data is saved even if power is turned off.



5. Outline of Standard Serial Communications Protocol

MAC10 adopts SHIMAX standard serial communications protocol.

Change of data is possible with the same communication format, even if the different series of equipment which adopts the standard serial protocol is connected.

5-1. Communication Procedure

(1) The relation between master and slave

- The personal computer, PLC (host) is master side.
- MAC10 is slave side.

- Communication begins by the communication command from the master side, and end by the communication response from the slave side.

However, communication response is not performed when abnormalities, such as communication format error or BCC error, have been recognized.

(2) Communication procedure

The slave side answers the master side, transmitting right shifts mutually, and communication procedure is performed.

(3) Timeout

After receiving a start character, when reception of an end character is not completed within 1 second, it is considered as a timeout. Wait another command (new start character).


In setting up timeout by the host side, set it up with 1 second or more.

5-2. Communication Format


(1) Communication format outline

Communication format consists of basic format part I, text part, and basic format part II.

1) Outline of communication command format

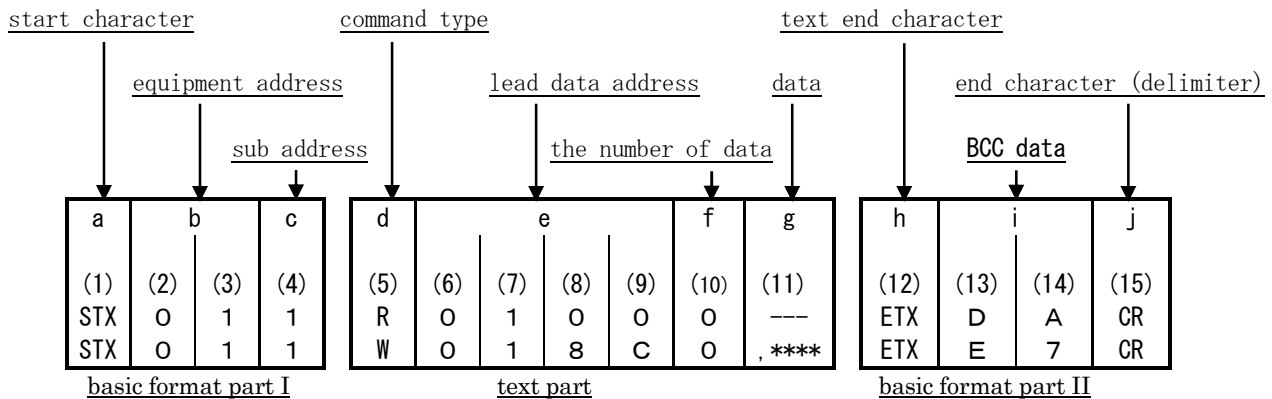

2) Communication answering format

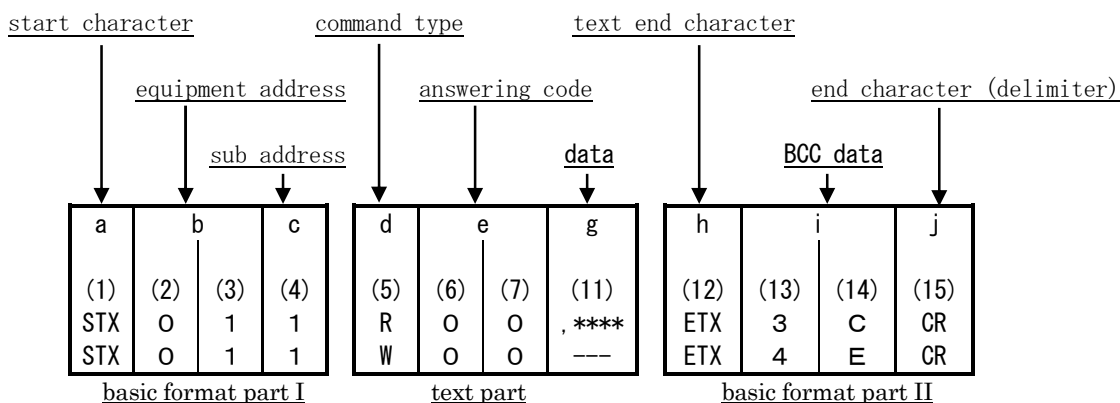

- Basic format part I, II is common at the time of Read command (R), Write command (W), and communication response.

The each-time operation result data is inserted into BCC data, < i (13), (14) >.

- Text part changes with command type, data address, communication responses, etc.

(2) Details of Basic format part I

a: Start character [(1): single-digit / STX (02H), or "@" (40H)]

- The character shows that this is head of communication.
- If start character is received, it will be judged as the 1st letter of new communication.
- A start character and the end character of text are chosen by a pair.
(See 4-4. **Setup of Start Character**)

STX (02H) ----chosen by ETX (03H)
"@"(40H) ----chosen by ":" (3AH).

b: Equipment address [(2), (3):double-digit]

- Appoint the equipment for communication.
- Address can be appointed in 1~255 (decimal number).
- Binary digit 8 bit data (1:0000 0001 - 255:1111 1111) are divided into top 4 bits and 4 bits of low ranks, and are changed into ASCII data.

(2): Data from which high 4 bits is converted into ASCII.

(3): Data from which low 4 bits is converted into ASCII.

c: Sub address [(4): single-digit]

- It is being fixed to (4) =1 (31H), because MAC10 is single loop equipment.
- When other addresses are appointed, it gives no response as sub address error.

(3) Details of Basic format part II

h: Text end character (12): single-digit / ETX (03H), or ":" (3AH)]

- It shows that the text part has just finished.

i: BCC data [(13) (14):double-digit]

- BCC data checks communication data's abnormality.
- When BCC error is shown as a result of BCC operation, it gives no response.
- There are the four following types of BCC operations.
(BCC operation type can be set up by 4-5. **Setup of BCC Operation Type**)

1) None

BCC operation is not performed. (13) and (14) are omitted.

2) Addition

Addition operation is performed in the unit of ASCII data 1 character (1 byte), from start character (1) to text end character (12).

3) Addition + Complement of 2

Addition operation is performed in the unit of ASCII data 1 character (1 byte), from start character (1) to text end character (12). From the operation result, low rank 1 byte's complement of 2 is taken.

4) Exclusive OR

XOR (exclusive OR) operation is performed in the unit of ASCII data 1 character (1 byte), from immediately after start character < equipment address (2) >to text end character (12).

- Regardless of data bit length (7 or 8), calculate in the unit of 1 byte (8 bits).

- According to the above-mentioned operation result, the low rank 1 byte data is divided into top rank 4 bits and 4 bits of low rank, and is changed into ASCII data.

(13): Data from which high 4 bits is converted into ASCII.

(14): Data from which low 4 bits is converted into ASCII.

Example 1: BCC At setup of Addition at the time of Read command (R).

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(12)	(13)	(14)	(15)
STX	0	1	1	R	0	1	0	0	0	ETX	D	A	CR

$$02H + 30H + 31H + 31H + 52H + 30H + 31H + 30H + 30H + 30H + 03H = 1DAH$$

Addition result (1DAH)'s low 1 byte = DAH

(13) : "D" = 44H , (14) : "A" = 41H

Example 2 : BCC At setup of Addition + Complement of 2 at the time of Read command (R)

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(12)	(13)	(14)	(15)
STX	0	1	1	R	0	1	0	0	0	ETX	2	6	CR

$$02H + 30H + 31H + 31H + 52H + 30H + 31H + 30H + 30H + 30H + 03H = 1DAH$$

Addition result's (1 DAH) low rank 1 byte = DAH

Complement of 2 low 1 byte (DAH) = 26

(13) : "2" = 32H , (14) : "6" = 36H

Example 3: BCC At Exclusive OR setup at the time of Read command (R).

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(12)	(13)	(14)	(15)
STX	0	1	1	R	0	1	0	0	0	ETX	5	0	CR

$$30H \oplus 31H \oplus 31H \oplus 52H \oplus 30H \oplus 31H \oplus 30H \oplus 30H \oplus 30H \oplus 03H = 50H$$

- = XOR (exclusive OR)

low rank 1 byte of operation result (50H) = 50H

(13) : "5" = 35H , (14) : "0" = 30H

j: End character (delimiter) [(15): single-digit / CR]

- This shows the end of communication.

(4) Basic format part I, II Common conditions

- 1) When the following abnormalities have been recognized in the basic format part, no answer is given.
 - when there happened hardware error. (overrun, flaming, parity error)
 - when equipment address and sub address differ from the address of appointed equipment.
 - when character is not in the proper position that determined in the above-mentioned communication format.
 - when the operation result of BCC differs from BCC data.
- 2) Binary digit (binary) data is converted into ASCII data every 4 bits.
- 3) In a hexadecimal number, <A>~<F> are converted into ASCII data using a capital letter.

(5) Text part outline

Text part changes with the type of command, and communication responses.

See **5-3. Read command (R) details** as well as **5-4. Write command (W) details** about details of text part.

d: Command type [(5):single-digit],

- "R" (52H/capital letter): This shows that they are read command and read command response.
Used when various data are read out (or read in) to a personal computer, PLC, etc.
- "W" (57H/capital letter): This shows that they are write command and write command response.
Used when various data are written in (or changed) from a personal computer, PLC, etc.
- On occasions when unusual characters other than "R" and "W" have been recognized, it gives no response.

e: Lead data address [(6), (7), (8), (9): four-digit]

- At the time of a Read command (R) and a Write command (W), read-out and the lead data address of writing place is appointed.
- Lead data address is appointed as binary digit data of 16 bits (1 word /0~65535).
- 16 bit data are divided every 4 bits, and are converted into ASCII data.

binary digit (16 bits)	D15,D14,D13,D12	D11,D10, D9, D8	D7, D6, D5, D4	D3, D2, D1, D0
	0 0 0 0	0 0 0 1	1 0 0 0	1 1 0 0
hexadecimal number	0 H	1 H	8 H	C H
	"0"	"1"	"8"	"C"
ASCII data	3 0 H	3 1 H	3 8 H	4 3 H
	(6)	(7)	(8)	(9)

- See **7. Communication Data Address List** about data address

f: The number of data [(10): single-digit]

- At the time of a Read command (R) and a Write command (W), the numbers of read-out and write-in data are appointed.
- The number of data is appointed by converting binary digit 4 bit data into ASCII data.
- At the time of a Read command (R), it is possible to appoint in the following range.
"0"(30H) (one) ~ "9" (39H) (ten)
- Being fixed to "0" (30H) (one) at the time of Write command (W).
- The actual number of data is < the number of data =appointed data value + 1 >

g: Data [(11): the number of digit is determined by data number]

- Write-in data at the time of Write command (W) (changed data) as well as the read-out data at the time of Read command (R) response are appointed.
- The data format is as follows.

g (11)

", " 2CH	1st data				2nd data				n-th data			
	high			lower	high			lower	hige			lower
	1	2	3	4	1	2	3	4	1	2	3	4

- Quotation (" "2CH) are, without fail, added to the head of data, and subsequent portion is data.
- The sign which divides between data and data is not employed.
- The number of data is determined with the number of data of communication command format f:(10).
- One data is expressed in the unit of binary digit, 16 bits (1 word) except decimal point.
- The positions of a decimal point differ from data to data.
- 16 bit data are divided every 4 bits, and each is converted into ASCII data.
- See **5-3. Read Command (R) Details**,and **5-4. Write Command (W) Details** about the details of data

e: Answering code [(6), (7):double-digit]

- Appointment of the answering code to Read command (R) and Write command (W).
- Binary digit 8 bit data (0~255) are divided into high rank 4 bits and low rank 4 bits, and each is converted into ASCII data.
 - (6): Data from which high 4 bits is converted into ASCII.
 - (7): Data from which low 4 bits is converted into ASCII.
- In the case of normal response, "0" (30H) and "0" (30H) are appointed.
- In the case of abnormal response, abnormal code NO. is converted to ASCII data and appointed.
- See **5-5. Answering Code Details** about details of answering code.

5-3. Read command (R) Details

Read command (R) is used when it reads in (take in) various data from a personal computer, PLC, etc.

(1) Read command (R) format

- Text part format at the time of Read command (R) is as follows.
- (Basic format part I and II are common to all the commands and responses.)

text part					
d	e				f
(5)	(6)	(7)	(8)	(9)	(10)
R	0	4	0	0	4
52H	30H	34H	30H	30H	34H

d: this means Read command.

e: lead data address of read-out data is appointed.

f: appointment of the number of data that should be read out of lead data address.

- The above-mentioned command is as follows.

read-out lead data address = 0400H (hexadecimal number)
 = 0000 0100 0000 0000 (binary digit)

the number of read-out data = 4H (hexadecimal number)
 = 0100 (binary digit)
 = 4 (decimal number)

(the actual number of data) = 5 (4+1)

Namely, read-out of five data from the data address 0400H is being appointed.

(2) The normal response format at the time of Read command (R)

- The normal response format (text part) to Read command (R) is as follows.
- (Basic format part I and II are common to all the commands and responses.)

text part															
d	e		g												
(5)	(6)	(7)	(11)												
R	0	0	1st data				2nd data				5 th data				
52H	30H	30H	2CH	30H	30H	31H	45H	30H	30H	37H	38H	30H	30H	30H	33H

- d (5) : <R (52H)> which shows that it is the response of Read command (R) is inserted.

- e (6),(7) : <00 (30H, 30H) >, which shows the normal response of Read command (R), is inserted.

- g (11) : The response data of Read command (R) is inserted.
The format of data is as follows.
 1. At first, <, (2CH) >, which shows the head of data, is inserted.
 2. Next, from <the data of read-out lead data address>, the same number of data as <the number of read-out data> is inserted in order.
 3. Nothing is inserted between data.
 4. One data consists of binary digit data, 16 bits (1 word) except a decimal point.
Data is converted into ASCII data every 4 bits and inserted.
 5. The positions of a decimal point differ from data to data.
 6. The number of characters of response data is as follows.
the number of character = 1 + 4 × the number of read-out data

- The following data is answered as response data, in order, to the above-mentioned Read command (R).

lead of read-out data address	data address 16 bits (1 word)		data 16 bits (1 word)	
	hexadecimal number	hexadecimal number	hexadecimal number	decimal number
(0400H) →	0	0400	001E	30
number of read-out data (4H : 5)	1	0401	0078	120
	2	0402	001E	30
	3	0403	0000	0
	4	0404	0005	5

(3) The abnormal response format at the time of Read Command (R)

- The abnormal response format (text part) to Read command (R) is as follows.
(Basic format part I and II are common to all the commands and responses.)

text part		
d	e	
(5)	(6)	(7)
R	0	7
52H	30H	37H

- d (5): <R (52H) >, which shows the answer of read command, is inserted.
- e (6), (7): answering code, which shows abnormal response of Read command (R), is inserted.
- See **5-5. Answering Code Details** about the details of abnormal code.
- Response data is not inserted in abnormal response.

5-4. Write Command (W) Details

Write command (W) is used when various data is written in (or changed) from a personal computer, PLC, etc.

1) Write command (W) format

-The text part format at the time of the Write command (W) is as follows.
 (Basic format part I and II are common to all the commands and responses.)

text part										
d	e				f	g				
(5)	(6)	(7)	(8)	(9)	(10)	(11)				
W	0	4	0	0	0	write-in data				
57H	30H	34H	30H	30H	30H	,	0	0	2	8
						2CH	30H	30H	32H	38H

- d: This shows Write command. It is being fixed as "W" (57H).
- e: The lead data address of Write-in (change) data is appointed.
- f: The number of write-in (change) data is appointed.
 The number of write-in data is fixed as "0" (30H) One.
- g: Write-in (change) data is appointed.
 1. <, (2CH) >, which shows the lead of data, is inserted.
 2. Next, write-in data is inserted.
 3. Data consists of binary digit data, 16 bits (1 word) except a decimal point, and it is converted into ASCII data every 4 bits, and inserted.
 4. The positions of a decimal point differ from data to data.

- The above-mentioned command is as follows.

Write-in lead data address	= 0400H	(hexadecimal number)
	= 0000 0100 0000 0000	(binary digit)
The number of write-in data	= 0H	(hexadecimal number)
	= 0000	(binary digit)
	= 0	(decimal number)
(the actual number of data)	= One (0+1)	
Write-in data	= 0028	(hexadecimal number)
	= 0000 0000 0010 1000	(binary digit)
	= 40	(decimal number)

Data address 0400H, write-in (change) of one data (40: decimal number) is appointed.

address(400H) → 0
 the number of write-in data
 One(0 1)

data address		data	
16 bits (1 word)		16 bits (1 word)	
hexa- decimal number	decimal number	hexa- decimal number	decimal number
0400	1024	0028	40
0401	1025	0078	120
0402	1026	001E	30

(2) The normal response format at the time of W0rite command (W)
 - The normal response format (text part) to Write command (W) is as follows.
 (Basic format part I and II are common to all the commands and responses.)

text part		
d	e	
(5)	(6)	(7)
W	0	0
57H	30H	30H

- d (5) : <W (57H)>, which shows response of Write command (W), is inserted.
- e (6), (7): <00 (30H, 30H)>, which shows normal response of Write command (W), is inserted.

(3) The abnormal answer format at the time of Write Command (W)

- The abnormal answer format (text part) to a Write Command (W) is as follows.
(Basic format part I and II are common to all the commands and responses.)


text part		
d	e	
(5)	(6)	(7)
W	O	9
57H	30H	39H

- d (5) : <W (57H)>, which shows answer of Write command (W), is inserted.
- e (6), (7) : Abnormal response, which shows abnormal answer of Write command (W), is inserted.
- See **5-5. Answering Code Details** about details of abnormal code.

5-5. Answering Code Details

1) The type of answering code

- The communication answer to Read command (R) and Write command (W) always contains the answering code.
- An answering code is roughly divided into two kinds.



- Answering code consists of binary digit, 8 bit data (0~255).
- The type of answering code is as follows.

Answering Code List

answering code		code type	content of code
binary	ASCII		
0000 0000	"0","0" : 30H,30H	normal answer	- Normal answering code
0000 0111	"0","7" : 30H,37H	Format error of text part	- when number other than 0~9 is appointed as the number of data - when ones other than 0~9 and A~F are included - when quotation ", "are not given to the appointed position
0000 1000	"0","8" : 30H,38H	Data address Error in the number of data	- when non-existing address is appointed - when read-only is written - when write-only is read - when numbers other than zero are appointed as the number of data, at the time of W command
0000 1001	"0","9" : 30H,39H	Data error	- when the write-in data exceeds the settable range
0000 1010	"0","A" : 30H,41H	Execution command error	- when execution command is received in the unsuitable state
0000 1011	"0","B" : 30H,42H	Write mode error	- when write command is received under circumstances where data rewriting is impossible (such case as rewriting of manual output value is performed during AUTO execution)
0000 1100	"0","C" : 30H,43H	Specification option error	- when the write command which contains unlisted specification or option's data is received

(2) The priority of answering code

As the value of answering code becomes low, the priority of answering code becomes high.
When plural answering codes occur, the high priority answering code is returned.

5-6. Communication Data Address Details

1) Data address

- As for a data address, a binary digit (16 bit data) is expressed with a hexadecimal number every 4 bits.

2) About read-out (read)/write-in (write).

- R/W is the data in which read-out and writing are possible
- R is read-only data.
- W is data only for writing.
- When the data address only for writing is appointed in Read command (R), and read-only data address is appointed in Write command (W), data address error is shown. And abnormal answering code, ="0" , "8" (30H, 38H), "data format of text part, data address, and errors in the number of data" ,is answered.

3) Data address and the number of data

- When the data address, which is not listed in data address, is appointed as lead data address, data address error is shown. And abnormal answering code, ="0" , "8" (30H, 38H), "data format of text part, data address, and errors in the number of data", is answered.
- When the data address, to which the number of data is added, becomes outside of listed data address, in the area of outside-address, "0000 H" (30H, 30H, 30H, 30H) is answered always as data.

4) Data

- Since each data does not have a decimal point (16 bit data), the check of data type and decimal point is needed. (See instruction manual of main body)
- In the case of the data whose unit is UNIT, measuring range determines the position of decimal point.
- All the data is treated as binary digit with a code (16 bit data: -32768 ~ 32767).

Example: Method to express data with a decimal point

hexadecimal number

20.0 → 200 → 00C8
 100.00 → 10000 → 2710
 -40.00 → -4000 → F060

Example: Method to express 16 bit data

data with code	
decimal number	hexadecimal number
0	0000
1	0001
~	~
32767	7FFF
-32768	8000
-32767	8001
~	~
-2	FFFE
-1	FFFF

5) Option-related parameter

- When the data address of parameter, which is not listed as an option, is appointed, the abnormal answering code , "0" , "C" (30H, 43H) "specification, option error", is answered to Read command (R) and Write command (W).

6) The parameter which is not displayed in an operator display because of operation specification or setting specification

- The parameter, which is not displayed (not used) in an operator display because of operation specification or setup specification, is possible to read-out in communication. However, in write-in, the abnormal answering code,"0" , "B" (30H, 42H) "write mode error", is answered.

6. Outline of MODBUS Communication Protocol

MODBUS has two kinds of modes or RTU mode and ASCII mode, and according to the setting content of **4-5. Setup of BCC Operation Type**, it changes automatically.

Comparison of RTU and ASCII mode

Item	RTU	ASCII
transmission code	binary 8 bits	ASCII
error-checking	CRC-16	LRC
start bit	1 bit	
data length	8 bits	
parity bit	none / even number / odd number	
stop bit	CRC-16	LRC
start character	none	":"(3AH)
end character	none	CR(0DH)+LF(0AH)
time interval of data	below time to be equivalent to 28 bits	one second or less

6-1. Communication Procedure

1) Relation between master and slave

- A personal computer and PLC (host) side is master side.
- MAC10 is slave side.
- Communication is started by communication command from master side, and completed by communication answer from slave side.

However, a communication answer is not performed when abnormalities, such as communication format error or BCC error etc., have been recognized.


2) Communication procedure

The slave side answers the master side, a transmitting right is transferred by turns, and a communication procedure is performed.

3) Communication data

RTU mode is 8-bit binary transmission.


In ASCII mode, 8-bit binary of RTU is converted to the two-letter ASCII code and transmitted.

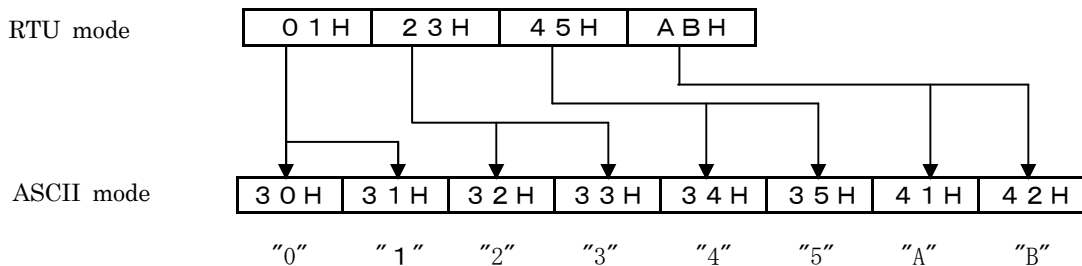

4) Message frame composition

RTU mode consists of only messages.

ASCII mode is consists of start character":" (3AH) + message + end character, CR (0DH) +LF (0AH).



5) Timeout

- RTU mode

When message stops during time equivalent to 28 bits, it is regarded as the end of message.

When a blank arises during time equivalent to 28 bits in the middle of message transmitting, it is judged as the end of message. It is an imperfect message, therefore slave performs no response.

* Reference: time equivalent to 28 bits (unit = msec)

9600bps:3.0 19200bps:1.5

- ASCII mode


After receiving start character, it results in timeout when reception of end character is not completed within 1 second. And it waits for the other command (new start character).

6-2. Communication Format

1) Composition of message


The MODBUS message has the following composition in RTU and ASCII mode.

All the message components are treated not by a decimal number but by a hexadecimal number.





2) Communication command format (MODBUS: Described by RTU because RTU is foundation)

- As for the message from master, message length is being fixed regardless of the function code.

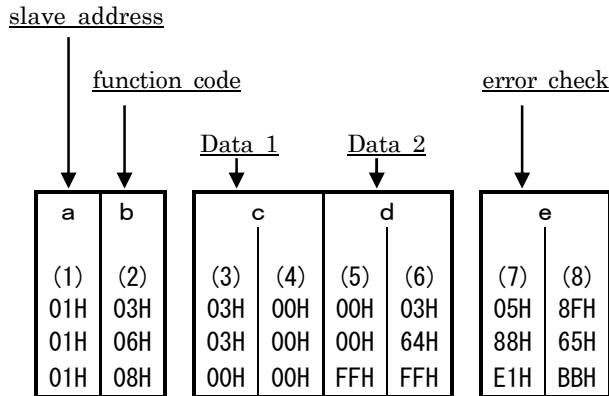

3) Communication answer format (MODBUS: Described by RTU because RTU is foundations)

- The answer from a slave differs in message length along with a function code.

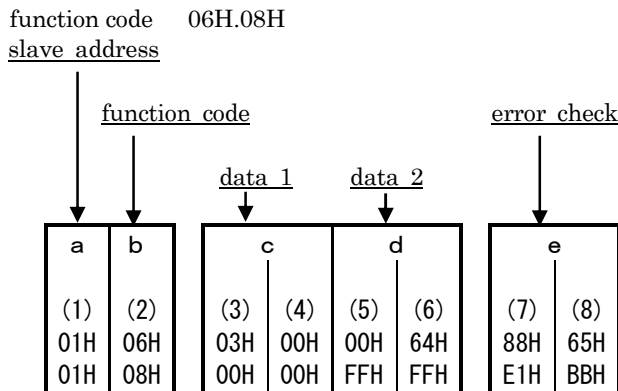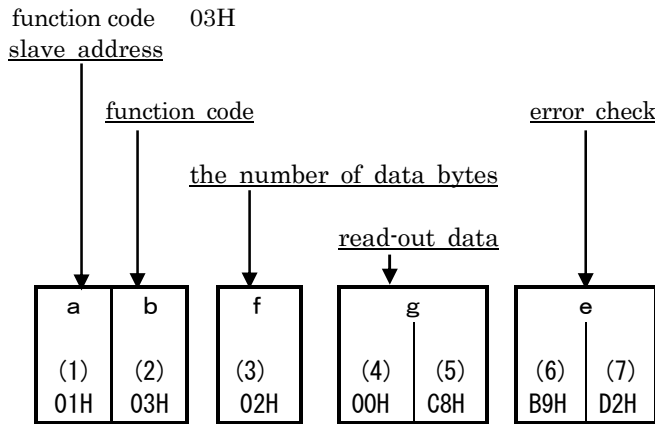

a: Slave address

- The message which the master sent is received by all the connected equipment. Only the slave congruous with message's slave address answers the message.
- In MAC10, 1~255 (01 H~FFH) can be appointed as slave address.

Note: In MODBUS specification, address which can be appointed to slave is 1~247 (01 H~F 7H)

b: Function code

- A code number shows the function to perform.

function code	function
0 3 H	data read-out
0 6 H	data writing
0 8 H	loopback test

c: Data 1

- Composition of data differs along with function code.

d: Data 2

- Composition of data differs along with function code.

function code	data 1 content	data 2 content
0 3 H	data address	the number of read-out
0 6 H	data address	write-in data
0 8 H	fixed as 0000H	arbitrary data

e: Error checking

- Error-checking system differs along with MODBUS mode.

RTU mode : CRC-16

ASCII mode : LRC

- See **6-3. Error Checking** about details concerning error checking.

f: The number of data bytes

- The number of read-out data bytes at the time of data read-out.
- Read-out demand is word unit; therefore it is twice of the number of read-out.

The number of read-out		The number of data bytes	
decimal number	hexa-decimal number	decimal number	hexa-decimal number
1	01H	2	02H
2	02H	4	04H
3	03H	6	06H
4	04H	8	08H
5	05H	10	0AH
6	06H	12	0CH
7	07H	14	0EH
8	08H	16	10H
9	09H	18	12H
10	0AH	20	14H

g: Read-out data

- The data along with read-out demand is inserted.
- Along with the number of read-out, data length varies and there is no data breaking.
The number of read-out is: 1 = 2 bytes, 3 = 6 bytes, and 10 = 20 bytes.

6-3. Error Checking

Error checking is calculated by the sending side and the result is attached to the end of outgoing message.

Error checking of incoming message is calculated by the reception side.

The result is checked if it is the same as received error checking.

If the check results met, incoming message is judged to be right, and answer operation to reception is started.

If it differs, data is judged as abnormal, and slave performs no response.

(1) CRC-16

CRC-16 is 2 bytes (16 bits) of error-checking code.

CRC-16 is calculated in the following procedures from slave address to the end of data.

1. to initialize CRC register by FFFFH.
2. Exclusive OR with CRC register and the first 1 byte of message.
A calculation result is written in CRC register.
3. Shift 1 bit of CRC registers to the right.
4. If carry fragment (shift-out bit) is 1, exclusive OR with CRC register and A001H.
The calculation result is written in CRC register.
5. Repeat 3. and 4. until it shifts eight times.
6. Exclusive OR with CRC register and 1 byte next to message.
The calculation result is written in CRC register.
7. 3.~ 6. is repeated to all the data except CRC.
8. Data byte is calculated to the end. The computed CRC register value is assigned to a message in order of low rank and high rank.

(2) LRC

LRC calculates from slave address to the end of data in the following procedures.

(Note: LRC calculation is performed by RTU binary, the antecedent method of ASCII binary)


1. Addition, from the lead of data (slave address) to the end, is carried out.
When a calculation result exceeds FFH, the value beyond 100H is omitted.(153H is treated as 53H)
2. The complement of addition's result (bit reversal) is taken, and 1 is added to the result.
3. The above-mentioned value works as the LRC code.
4. The LRC code is assigned to the end of message, and the whole is converted into the ASCII character.

6-4. Data Read-out (Function Code 03H) Details

Function code 03H is used on occasions when it reads (takes in) various data from a personal computer, PLC, etc.

(1) Data read-out format

- The format at the time of data read-out is as follows.

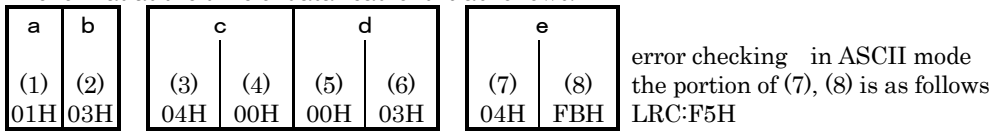

a: Slave address

b: Data read-out function code

c: Read-out lead data address

d: The number of read-out data from lead data address

* The numbers of data which can be read is 1~10.

Therefore, binary code permitted here is 0001H~000AH, and error code is returned if value other than the above is appointed.

e: Error checking

- The above-mentioned command is as follows.


Read-out lead data address = 0400H (hexadecimal number)

The number of read-out data = 0003H (hexadecimal number)

Three data read-out is appointed from data address 0400H

(2) The normal answer format at the time of data read-out

- The normal answer format to function code 03H is as follows.

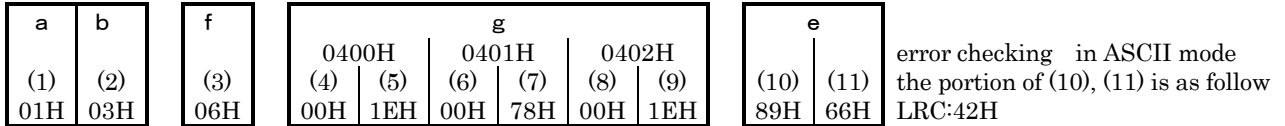

a: Slave address

b: Function code

f: The number of read-out data bytes

* three data read-out, so 6 bytes read-out. Therefore, it is 06H.

g: Read-out data


1. The same number of data as that of read-out data is inserted from read-out's data of lead data address, in order.

2. Nothing is inserted between data.


3. One data consists of binary digit 16 bits data(1 word) except for a decimal point.

4. Each data has position of peculiar decimal point.

e: Error checking

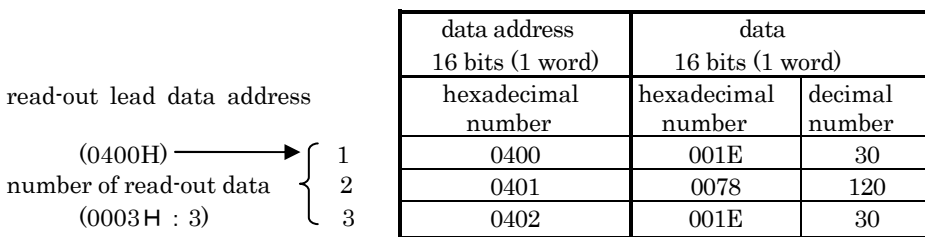

(3) The abnormal answer format at the time of data read-out

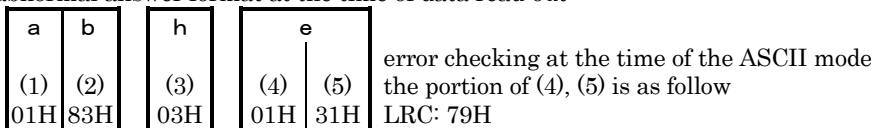

a: Slave address

b: Function code

* At the time of error, reception function code +80H is shown. It informs abnormal answer.

h: Error code

* See **6-8. Error Message Details** about details of error code.


e: Error checking

6-5. Data Write-in (Function Code 06H) Details

Function code 06H is used on occasions when it writes in (changes) various data from a personal computer, PLC, etc.

(1) Data write-in format

- The format at the time of data writing is as follows.

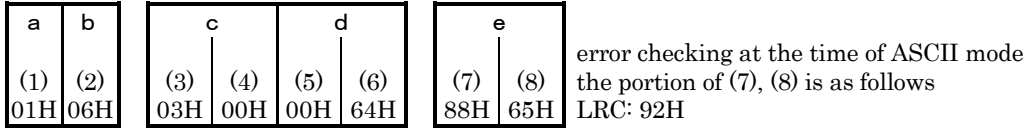

a: Slave address

b: Data write-in function code

c: A write-in data address

d: Write-in data

1. Data consists of binary digit 16 bits data (1 word) except for a decimal point.
2. Each data has position of peculiar decimal point.

e: Error checking

- The above-mentioned command is as follows.


write-in lead data address = 0300H (hexadecimal number)
write-in data = 0064H (hexadecimal number)
= 100 (decimal number)

Writing of the data addresses, 0300H (100:10 decimal numbers), is appointed.

	data address 16 bits (1 word)		data 16 bits (1 word)	
	hexadecimal number	hexadecimal number	hexadecimal number	decimal number
address (0300H) →	0300	0064	100	
write-in data (0064H)	0301	0000	0	
	0302	0000	0	


(2) The normal answer format at the time of data writing

- The normal answering format to function code 06H is as follows.

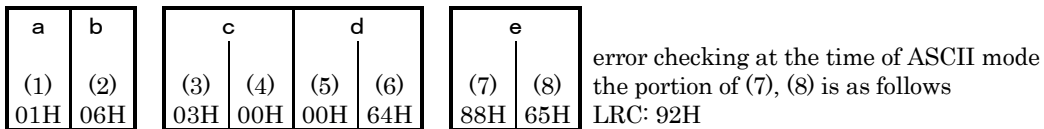

* The same one as the outgoing message from master is answered.

(3) The abnormal answer format at the time of data writing

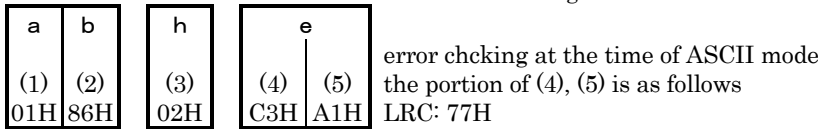

a: Slave address

b: Function code

* At the time of error, reception function code +80H is shown. It informs abnormal answer.

h: Error code

* See **6-8. Error Message Details** about error code details.


e: Error checking

6-6. Loopback Test (Function Code 08H) Details

The function code 08H returns the message from master as response message as it is. It is used as communication diagnosis between master and slave.

(1) Loopback format


- The format at the time of a loopback test is as follows.

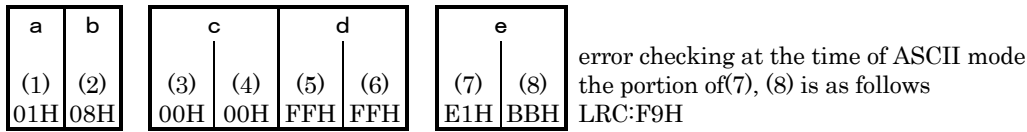

- a: Slave address
- b: Loopback test function code
- c: Test code
 - * Fixed as 0000H
- d: Arbitrary data
 - * arbitrary 16 bit data of 0000H~FFFFH
- e: Error checking


(2) Loopback normal answer format

- The normal answer format to the function code 08H is as follows.

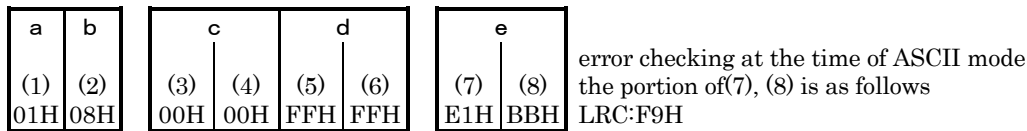

- * The same one as the outgoing message from master is answered.

(3) The abnormal answer format at the time of loopback

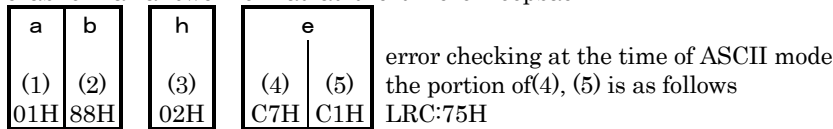

- a: Slave address
- b: Function code
 - * At the time of error, reception function code +80H is shown. It informs abnormal answer.
- h: Error code
 - * See **6-8. Error Message Details** about error code details.
- e: Error checking

6-7. No Response Conditions

Slave does not answer when the following abnormalities have been recognized.

- when hardware error takes place (overrun, framing, parity error)
- when slave address differs from its own address
- when the data interval of message is long.
(RTU: time to be equivalent to 28 bits or more, ASCII: one second or longer)
- when CRC-16 or LRC differs.
- when the message from master is not regulated one (Message is too long etc.,)

6-8. Error Message Details

Error code corresponding to the type of error is answered, when error other than no response condition is detected.

(1) Abnormal answer format

a	b
(1)	(2)
01H	83H

h
(3)
03H

e
(4) (5)
01H 31H

error checking at the time of ASCII mode
the portion of (4), (5) is as follows
LRC:79H

a: Slave address

b: Function code

1. At the time of error, reception function code +80H is shown. It informs abnormal answer.
2. +80H is not shown at the time of function code beyond 80H, and returned as it is.

h: Error code

* See the following table.

e: Error checking

Error Code	Content of Errors
01H	Function code error - when function code other than regulated one is received (All other than three sorts, < 03H, 06H, 08H>, correspond to this category)
02H	Address error - when it is written in the address only for reading - when the address only for writing is read - when a test code is not 0000H at the time of loopback test - when non-existing address is appointed in the lead of read-out or write-in address. (not yet added option etc. is included)
03H	Data error - when write-in data exceeds the writable data range (when ones other than 0 and 1 are written in AUTO/MANU switching etc.) - when the written-in value had been already filled by other one, in the item only for an exclusion setup. - when the number of read-out data and the number possible to read-out is different. (In MAC10, read-out is permitted between 1~10.) An error code is answered when read-out is 0, or over 11. - when parameter is rewritten under circumstances a change is not permitted (Items such as: at the time of change by key operation, a screen displays nothing or a change is impossible)

(2) The priority of error code

The priority of error code becomes high as the value of error code becomes small. On occasions when plural error codes occur, the high priority error code is returned.

Example: Even if there are data error and address errors, 01H is returned when function code error is detected.

6-9. Communication Data Address Details

- (1) Data address
 - As for data address, binary digit (16 bit data) is expressed with hexadecimal number every 4 bits.
- (2) About read-out (read)/write-in (write).
 - R/W is the data in which read-out and writing are possible
 - R is read-only data
 - W is data only for writing.
 - when the data address only for writing is appointed in data read-in (Function code 03H),
 - when the read-only data address is appointed in data write-in (Function code 06H), it becomes address error and error code 02H is answered.
- (3) Data address and the number of data
 - When the data address, which is not described in data address, is appointed as lead data address, it becomes address error and error code 02H is answered.
 - When the data address, to which the number of data is added, becomes outside of listed data address, in the area of outside-address, as data 0000 H is answered always.
- (4) Data
 - Since each data does not have a decimal point (16 bit data), the check of data type and decimal point is needed.
(See the instruction manual of main body)
 - In the case of the data whose unit is UNIT, measuring range determines the position of a decimal point.
 - All the data is treated as binary digit with a code (16 bit data: -32768 ~ 32767).

Example: Method to express data with a decimal point

Hexadecimal data

20.0 → 200 → 00C8
 100.00 → 10000 → 2710
 -40.00 → -4000 → F060

Example: Method to express 16 bit data

data with code	
decimal number	hexadecimal number
0	0000
1	0001
~	~
32767	7FFF
-32768	8000
-32767	8001
~	~
-2	FFFE
-1	FFFF

- (5) An option-related parameter
 - When the data address of the parameter, which is not listed as an option, is appointed, it results in an error both at Read command (R) and Write command (W). And error code 02H is answered
- (6) The parameter which is not displayed in an operator display because of operation specification or setting specification
 - The parameter, which is not displayed (not used) in an operator display because of operation specification and setup specification, is possible to read-out in communication.
However, write-in becomes data error and error code 03H is answered.

7. Communication Data Address List

data Addr. (Hex)	Setting range	R/W
0040	Series Code 1 "M","A" 4DH,41H	R
0041	Series Code 2 "C","A" 43H,41H	R
0042	Series Code 3 Equipment Size "A","0" 41H,30H (MAC10: "A0" only)	R
0043	Series Code 4 Input Specification + Control Output 1 (See the following parts)	R

input spec	output spec	address	
		0043H	
M	C	"M" 4DH	"C" 43H
I	S	"I" 49H	"S" 53H
	I		"I" 49H

0044	software version code 1	R
0045	software version code 2	R

- Software version is expressed with four-digits and a decimal point is placed between data address 0044 and 0045.

Example: Version 1.00 Address H L H L
 0044 "0","1" 30H, 31H
 0045 "0","0" 30H, 30H

0046	option code event output + communication	R
------	--	---

event output	communication	address	
		0046H	
N	N	"N" 4EH	"N" 4EH
1	R	"1" 31H	"R" 52H
2		"2" 32H	

0100	测量值 PV 范围：在量程范围内	HHHH,CJHH,b---:7FFFH LLLL,CJLL:8000H	R
0101	当前设定值 SV		R
0102	控制输出	0.0~100.0 (%)	R

data Addr. (Hex)	Setting range	R/W
0104	工作状态 D15 D14 D13 D12 D11 D10 D9 D8 D7 D6 D5 D4 D3 D2 D1 D0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 AT/W:AT待机时 ON STBY:脱机(待机)时ON MAN:手动控制时ON AT:AT自整定时 ON	R
0105	报警状态 D15 D14 D13 D12 D11 D10 D9 D8 D7 D6 D5 D4 D3 D2 D1 D0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 EV1:EV1 LED灯亮时 ON EV2:EV2 LED灯亮时 ON	R
0106	Operation FIX-SV No. 1-4	R

010D	自锁状态 D15 D14 D13 D12 D11 D10 D9 D8 D7 D6 D5 D4 D3 D2 D1 D0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 在自锁操作状态中 自锁时相应报警位变为ON	R
010E	继电器ON/OFF吸合状态 D15 D14 D13 D12 D11 D10 D9 D8 D7 D6 D5 D4 D3 D2 D1 D0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 0 当继电器吸合时 相应报警位变为ON	R

0110	报警1时间监控 0-600 -1:END	R
0112	报警2时间监控 0-600 -1:END	R

0180	FIX-SV No. 1-4	W
------	----------------	---

0182	手动控制输出 0-100% (仅在手动控制时有效)	W
0184	AT自整定执行 OFF:0 ON:1	W
0185	手动/自动控制切换 自动:0 手动:1	W
0186	运行(RUN)/待机(STBY)切换 RUN:0 STBY:1	W

0198	自锁解除 EV1:1 EV2:2 全部:4	W
------	-----------------------	---

0300	FIX 设定值 SV1 在SV限幅内	R/W
0301	FIX 设定值 SV2 在SV限幅内	R/W
0302	FIX 设定值 SV3 在SV限幅内	R/W
0303	FIX 设定值 SV4 在SV限幅内	R/W

030A	SV限幅下限 在量程范围内	R/W
030B	SV限幅上限 在量程范围内	R/W

0400	比例带 P OFF:0 0.1~999.9	R/W
0401	积分时间 I OFF:0 1~6000	R/W
0402	微分时间 D OFF:0 1~3600	R/W
0403	手动积分 MR -50.0~50.0	R/W
0404	位式灵敏度下限 1~999	R/W
0405	输出限幅下限 0.0~99.9	R/W
0406	输出限幅上限 0.1~100.0	R/W
0407	位式灵敏度上限 1~999	R/W

data Addr. (Hex)	Setting range			R/W
0500	EV1	报警模式 见报警事件代码表 See <i>Event Code Table</i>		R/W
0501		报警1的报警值 *在SHIMAX协议时 若报警模式设为 NON SO 和RUN 时 此参数无效 范围 -1999至9999		R/W
0502		报警回差 1 ~ 999		R/W
0503		报警抑制 OFF:0 1-2		R/W
0505		事件自锁/输出特性 D15-8 D7-0 自锁 输出特性 报警自锁的高八位 报警输出特性在低八位 自锁 OFF:0 ON:1 输出特性 NO:0 NC:1		R/W
0506		报警ON的延时时间 0 (OFF) 1-8000		R/W
0507		报警OFF的延时时间 0 (OFF) 1-8000		R/W
0508		EV2	报警2的报警模式 见报警事件代码表	
0509	报警2的报警值 *在SHIMAX协议时 若报警模式设为 NON SO 和RUN 时 此参数无效 范围 -1999至9999		R/W	
050A	报警回差 1 ~ 999		R/W	
050B	报警抑制 OFF:0 1-2		R/W	
050D	事件自锁/输出特性 D15-8 D7-0 自锁 输出特性 报警自锁的高八位 报警输出特性在低八位 自锁 OFF:0 ON:1 输出特性 NO:0 NC:1		R/W	
050E	报警ON的延时时间 0 (OFF) 1-8000		R/W	
050F	报警OFF的延时时间 0 (OFF) 1-8000		R/W	
05B0	通讯储存方式 RAM:0 MIX:1 EEP:2			R/W
0600	加热RA/制冷DA RA:0 DA:1			R/W
0601	输出周期 0.5-120.0 秒 (电流输出时无效)			R/W
060A	输出缓启动时间 0.5-120.0秒			R/W
0611	按键锁 OFF:0 1~3,5			R/W
0612	上电执行方式 0:EEP 1:STBY 2:RUN			R/W
0700	PV增益修正 -500~500			R/W
0701	PV偏移 -500~500			R/W
0702	PV滤波 0~100			R/W
0704	温度单位 °C:0			R
0705	量程 见输入量程代码表			R/W
0707	小数点位置 ****:0 ***:1 **:2 *:3			R/W
0708	直流输入刻度下限 -1999~9989			R/W
0709	直流输入刻度上限 下限+10~9999			R/W
070F	热电偶断线显示 H:0 L:1			R/W
0B80	报警延迟模式 0:DELAY 1:TIMER1 2:TIMER2			R/W
0B81	定时器 ON 时间 1-600			R/W
0B82	定时器 OFF 时间 1-600			R/W
0B83	定时器时间单位 0:秒 1:分			R/W
0B88	报警延迟模式 0:DELAY 1:TIMER1 2:TIMER2			R/W
0B89	定时器 ON 时间 1-600			R/W
0B8A	定时器 OFF 时间 1-600			R/W
0B8B	定时器时间单位 0:秒 1:分			R/W

8. Supplementary Explanation

8-1. Measuring Range Code Table

输入		代码	字符	Measuring range	
				范围	
自由输入 M	热电偶	01	K1	0 ~ 1300	°C
		02	K2	-50.0 ~ 999.9	
		03	J1	0 ~ 600	
		04	J2	0.0 ~ 600.0	
	铂电阻	05	P1	-100.0 ~ 200.0	
		06	P2	-100 ~ 200	
		07	P3	-199.9 ~ 300.0	
		08	P4	-200 ~ 300	
	mV	09	M1	0 ~ 50mV	Scaling function is available(see below)
Current	mA	10	MA1	4 ~ 20mA	
		11	MA2	0 ~ 20mA	

By scaling function, measuring range can be set up in the following range arbitrarily.

Scaling range : - 1999 ~ 9999 count

Span : 10 ~ 10000 count

lower limit side < upper-limit side

8- 报警事件代码表

	报警类型	代码	初值	范围
<i>nan</i>	无	0	-----	-----
<i>HR</i>	上限绝对值	1	量程上限	量程内
<i>LR</i>	下限绝对值	2	量程下限	量程内
<i>Sp</i>	超量程	3	超出量程后报警	
<i>Hd</i>	上限偏差	4	2000	-1999 ~ 2000 unit
<i>Ld</i>	下限偏差	5	-1999	-1999 ~ 2000 unit
<i>ld</i>	偏差内报警	6	0	0 ~ 2000 unit
<i>od</i>	偏差外报警	7	2000	0 ~ 2000 unit
<i>run</i>	运行报警	8	运行报警	

9. ASCII Code Table

b 4 ~ b 1	b 7 ~ b 5	0 0 0	0 0 1	0 1 0	0 1 1	1 0 0	1 0 1	1 1 0	1 1 1
		0	1	2	3	4	5	6	7
0 0 0 0	0	NUL	TC7 (DLE)	S P	0	@	P	`	p
0 0 0 1	1	TC1 (SOH)	DC1	!	1	A	Q	a	q
0 0 1 0	2	TC2 (STX)	DC2	"	2	B	R	b	r
0 0 1 1	3	TC3 (ETX)	DC3	#	3	C	S	c	s
0 1 0 0	4	TC4 (EOT)	DC4	\$	4	D	T	d	t
0 1 0 1	5	TC5 (ENQ)	TC8 (NAK)	%	5	E	U	e	u
0 1 1 0	6	TC6 (ACK)	TC9 (SYN)	&	6	F	V	f	v
0 1 1 1	7	BEL	TC10 (ETB)	'	7	G	W	g	w
1 0 0 0	8	FE0 (BS)	CAN	(8	H	X	h	x
1 0 0 1	9	FE1 (HT)	EM)	9	I	Y	i	y
1 0 1 0	A	FE2 (LF)	SUB	*	:	J	Z	j	z
1 0 1 1	B	FE3 (VT)	ESC	+	;	K	[k	{
1 1 0 0	C	FE4 (FF)	IS4 (FS)	,	<	L	\	l	
1 1 0 1	D	FE5 (CR)	IS3 (GS)	-	=	M]	m	}
1 1 1 0	E	S0	IS2 (RS)	.	>	N	^	n	~
1 1 1 1	F	SI	IS1 (US)	/	?	O	_	o	DEL

The contents of this instruction are subject to change without notice.

SHIMAX CO.,LTD.

Head Office

190 shimoniyachi, aza, yotsuya, Daisen-shi, Akita 014-0102 Japan
 Phone +81-187-86-3400 FAX +81-187-62-6402
 URL <http://www.shimax.co.jp> E-MAIL info@shimax.co.jp

PRINTED IN JAPAN